
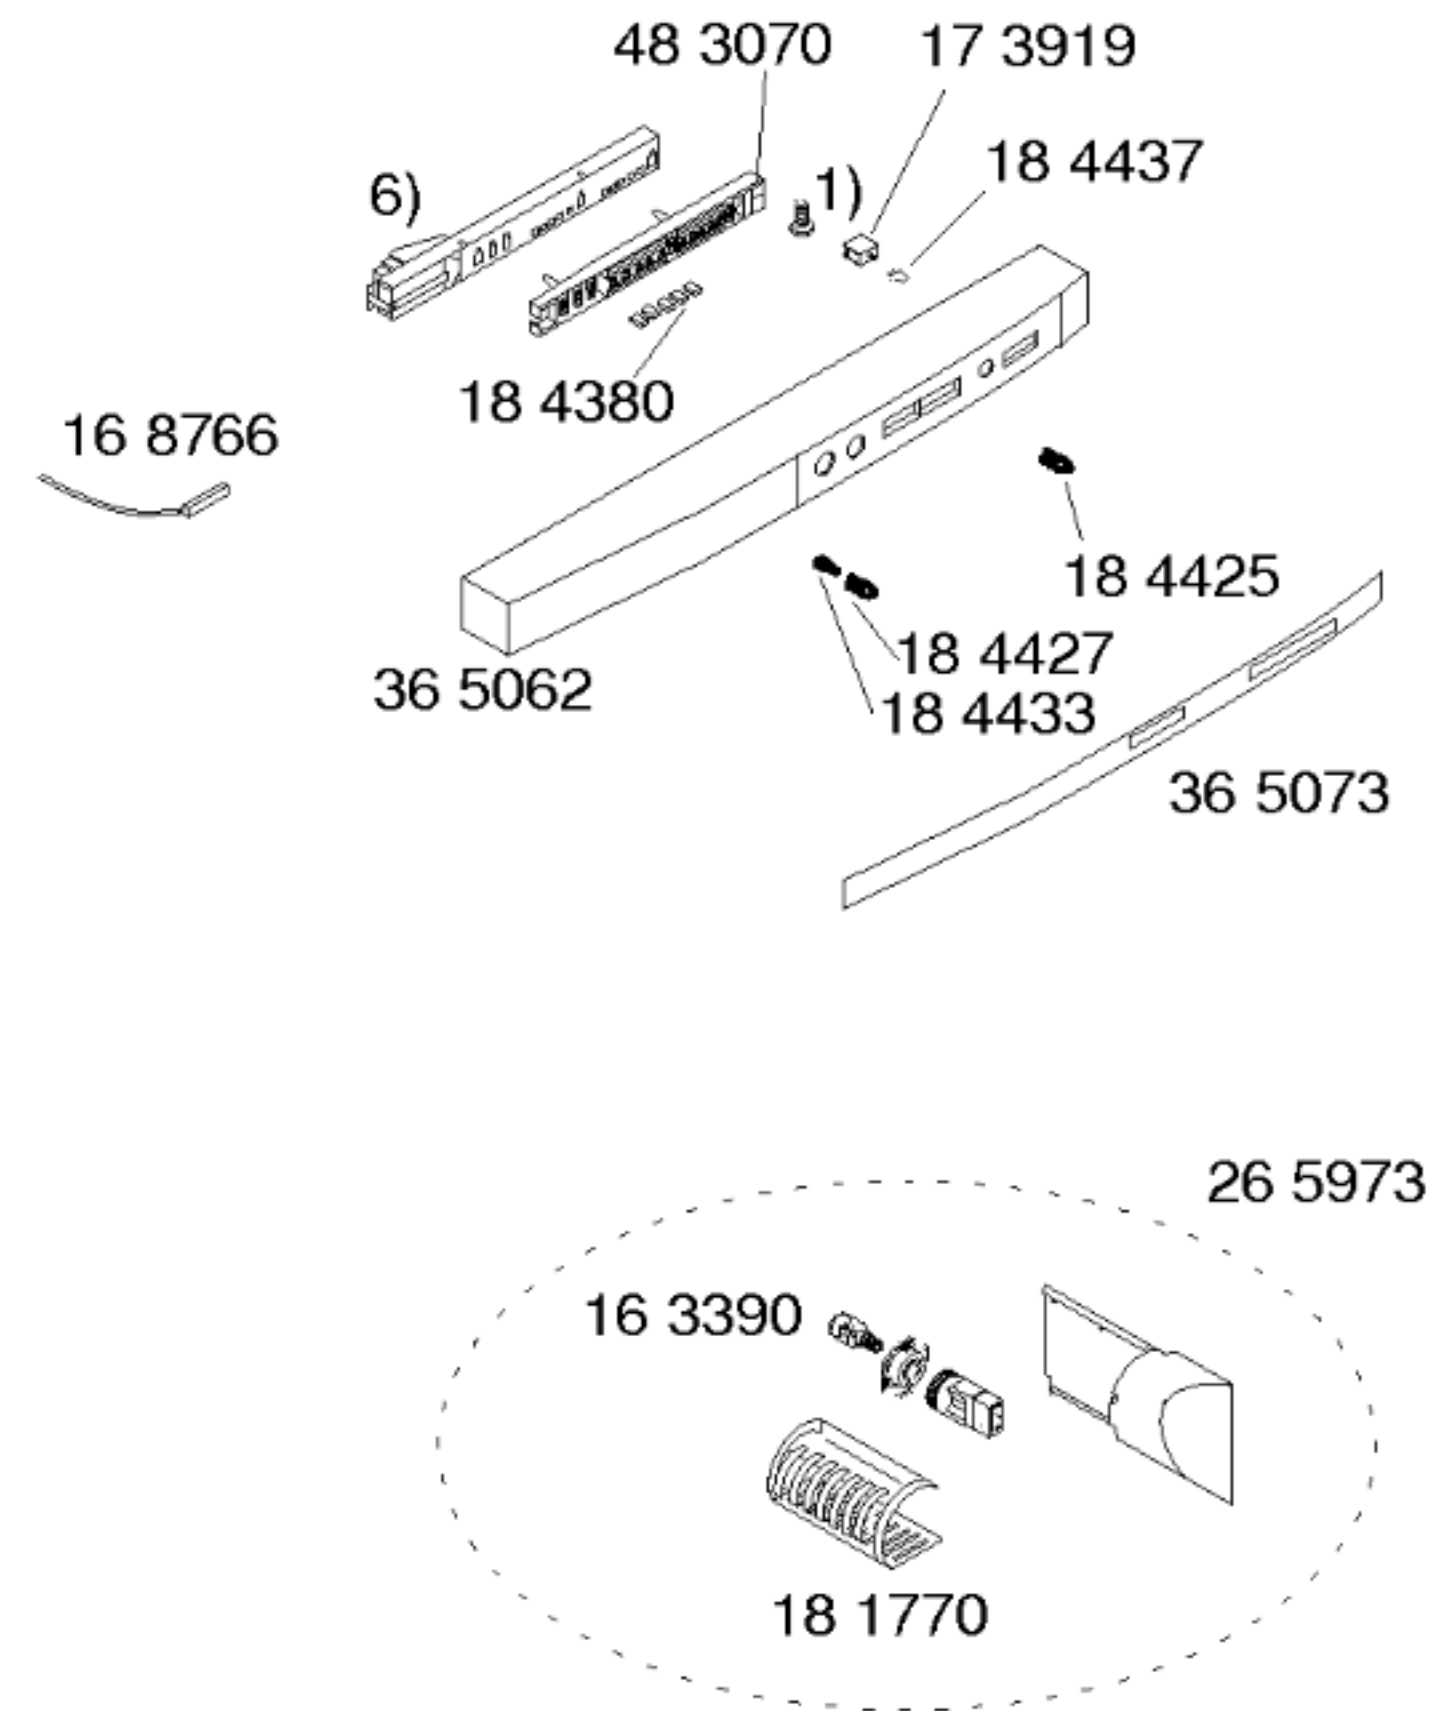


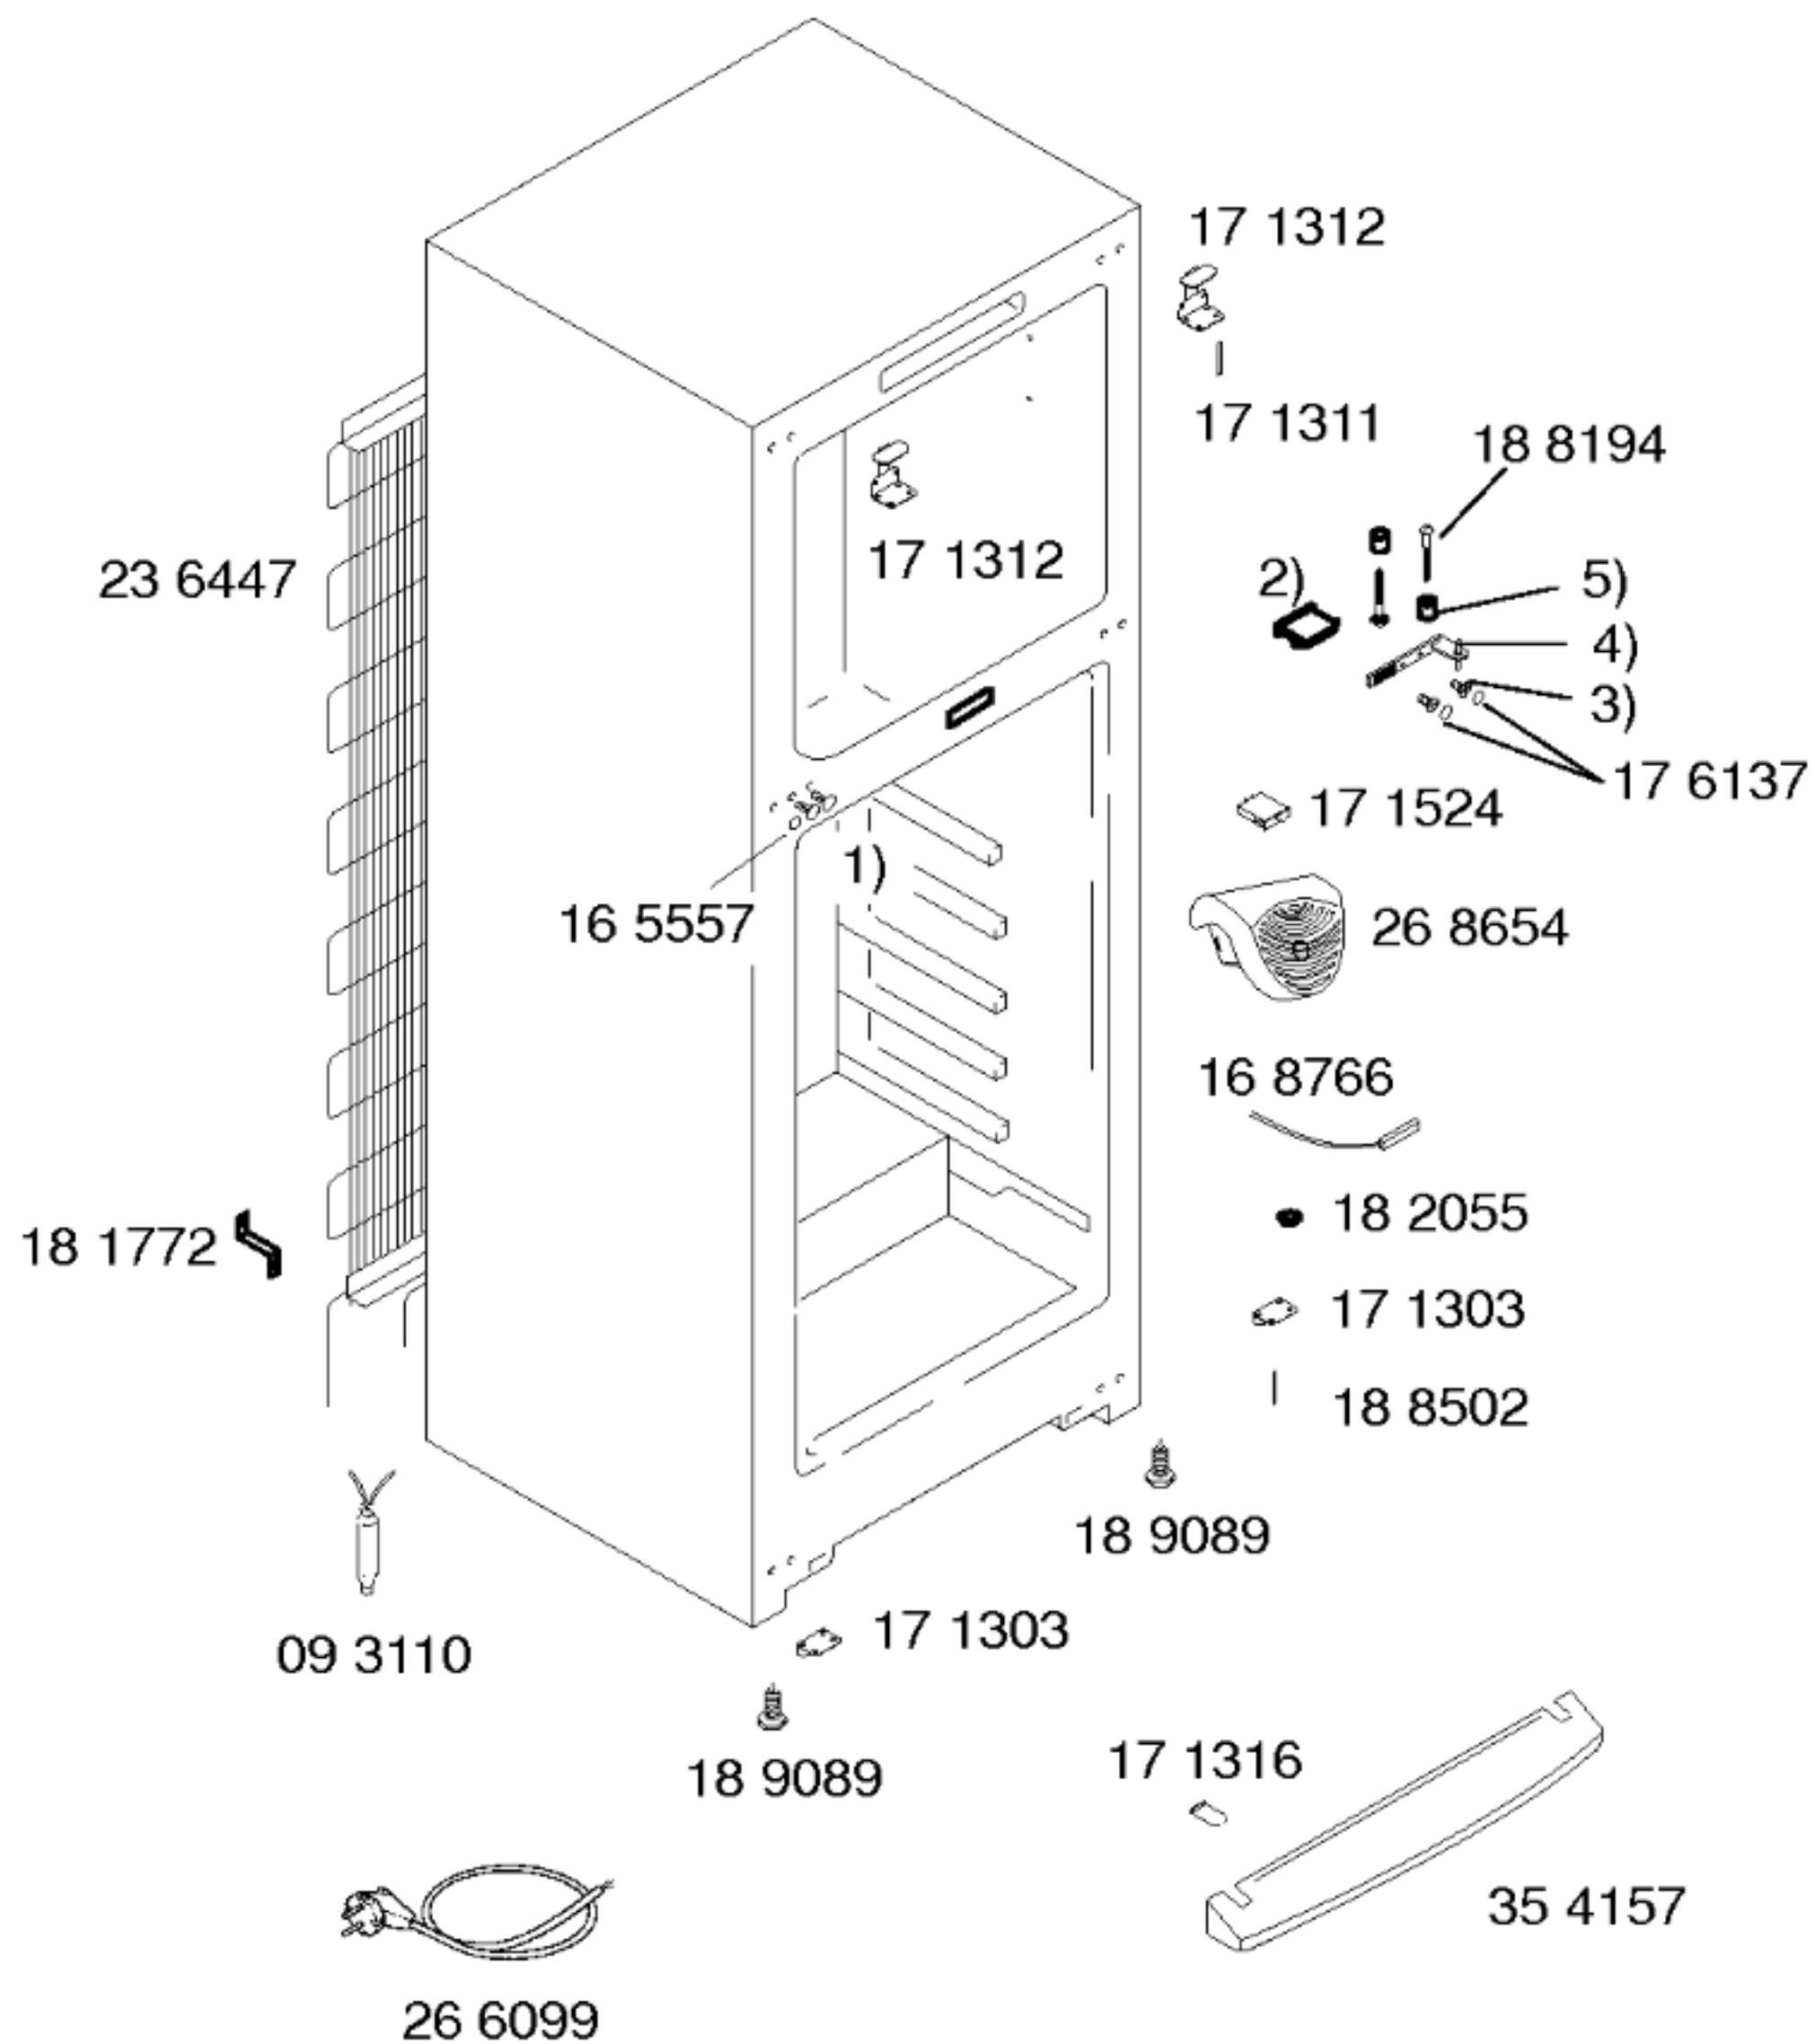

Mat. - Nr. - Konstante
3740

Gebrauchsanweisung
58 3372

V01,V02,V03

(DE,EN,FR,NL,IT,
ES,PT)

58 4115

V04,V05

(DE,EN,FR,NL,IT,ES
PT,HU)

1) 16 5552

2) 18 8197

V01,V02

41 8128

V03,V04,V05

3) 18 8196

4) 18 8191

5) 18 8188

6) 48 4095

V01,V02


48 8344

V03


48 9149

V04,V05

Mat. - Nr. - Konstante
3740

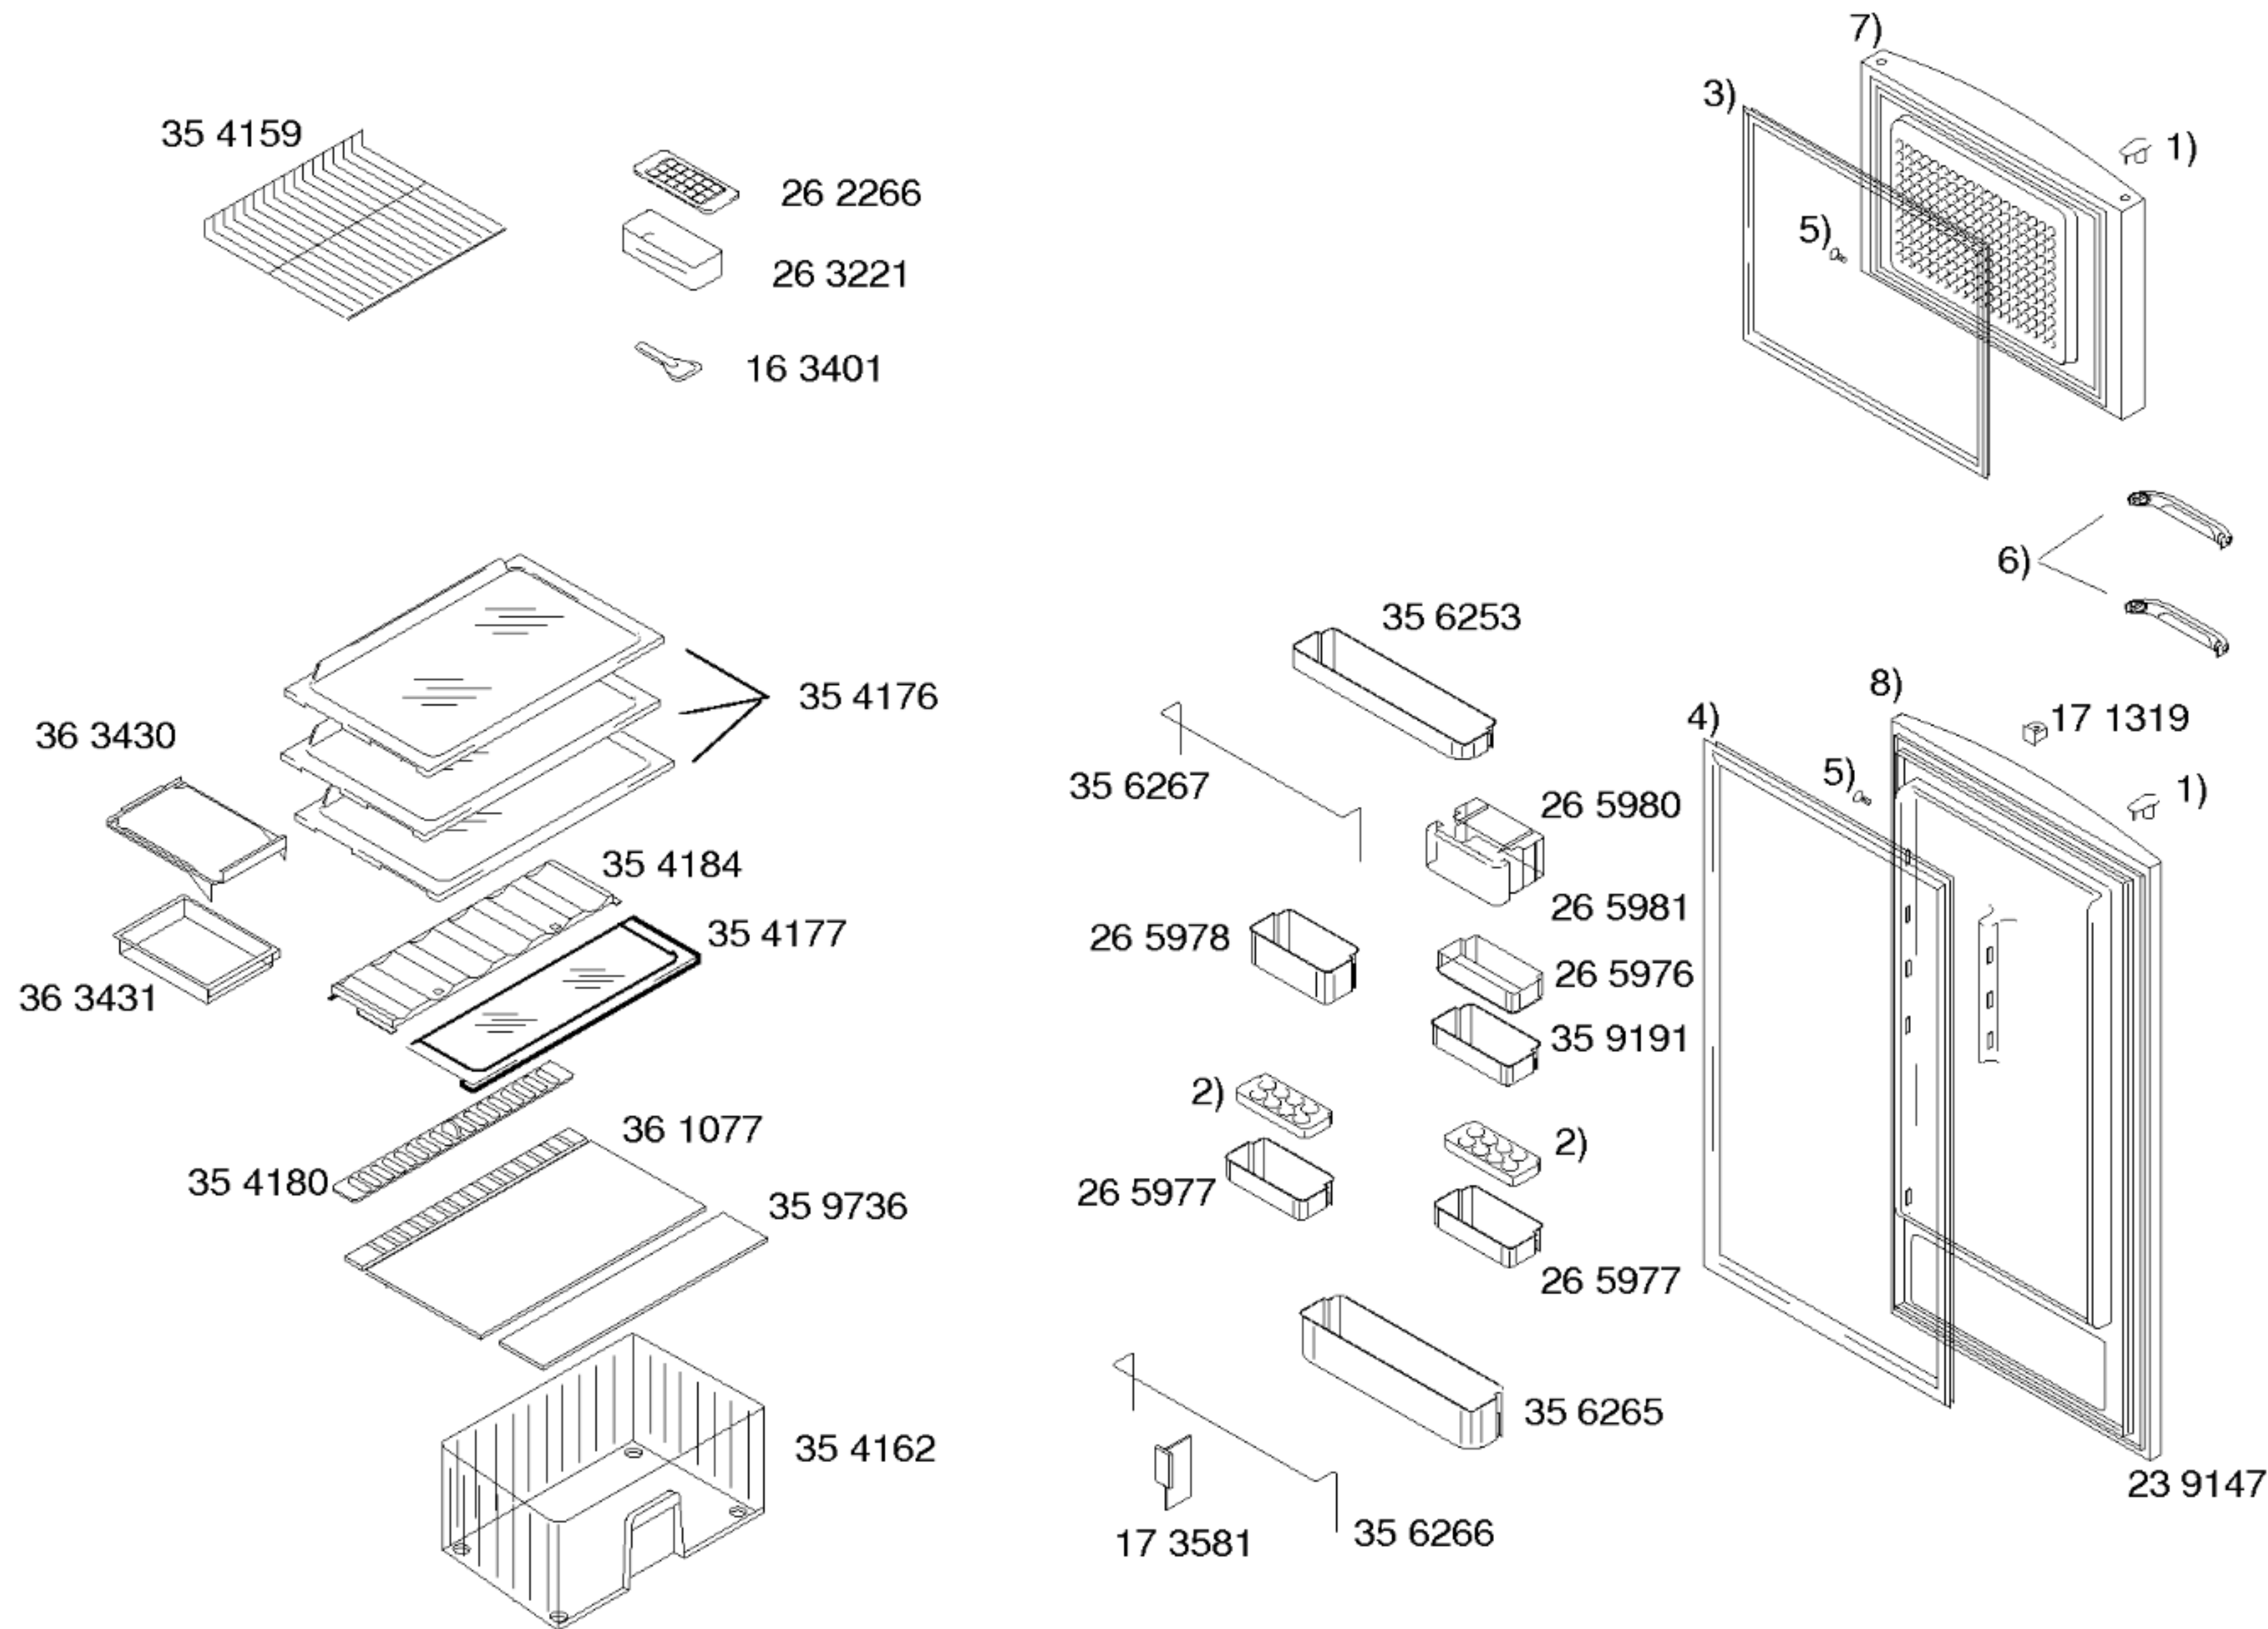

- 1) 17 1321
- 2) 26 7186
- 3) 21 6800
- V01
- 21 8855
- V02,V03,V04
- 4) 23 6355
- V01
- 23 8422
- V02,V03,V04,V05
- 5) 16 6484
- 6) 26 5975
- V01,V02,V03
- 48 8916
- V04,V05
- 7) 21 9580
- V01,V02,V03
- 21 9837
- V04,V05
- 8) 23 9147
- V01,V02,V03
- 23 9389
- V04,V05
- 9) 41 7890
- V04,V05

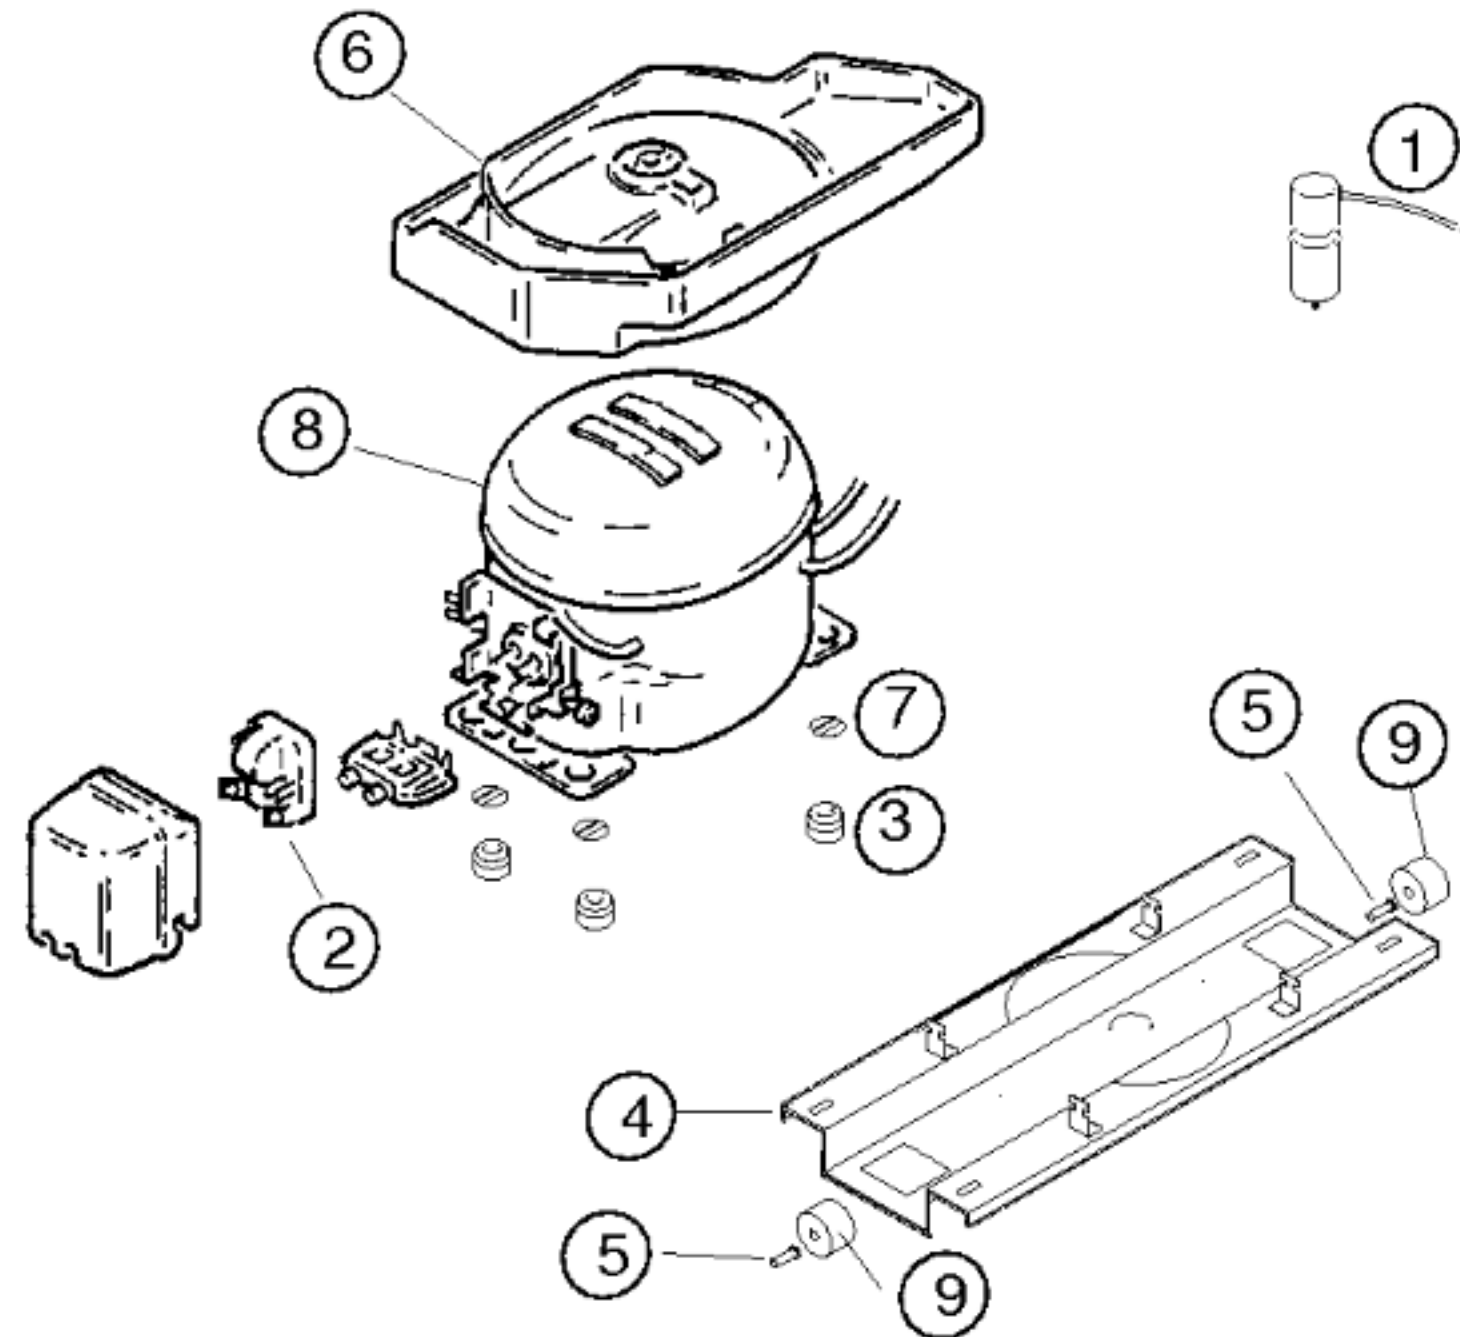

Pos.	Matsushita		
	DC125E12		
1	17 4093		
2	18 3872		
3	16 3427		
4	35 4158		
5	17 1318		
6	09 1308		
7	17 1519		
8	14 2169		
9	18 1014		
10			
11			
12			

TECHNISCHE DATEN/TECHNICAL DATA/TEKNIK BİLGİLER			
Verdichter/Compressor/Kompresör	Matsushita		
Typ/Type/Tip	DC125E12		
Förderleistung/Delivery/Verim/h	2074		
Anlaufstrom/Starting current/Giris akimi	10,9	A	
Widerstand/Resistance/Rezistans Ha/	12,7	Ohm	
Hi/aux.	18,0		
Temp.Reyler/Thermostat/Termostat	Electronic		
Typ/Type/Tip			
Reglerstellung/Position/Termostat pozisyonu			
Schaltwerte/Actua kapama degerleri	..ein/acma °C		
Valeurs de commutation/Termostat degeri	..aus"/kapama		
(..abtaven' od)	..alarm'		
Füllmenge/Fill. quantily/ Dolum miktarı	R600a	g	*
Anschlusswert/Comm. load/Giris gucu	W	*	
Heizung/Heater/Rezistans			
Widerstand/Resistance/Direnc	Ohm		
Leistung/Power/Guc	W		
Ventilador/Blower/Vantilatör			
Widerstand/Resistance/Rezistans	Ohm		
Magnetventil/Magnetic valve/Manyetik valf			
Widerstand/Resistance/Rezistans	Ohm		
Spannung/Voltage/Gerilim	V		
Temp.Reyler/Thermostat/Termostat			

* Siehe Typenschild/Mamul etiketine bakiniz